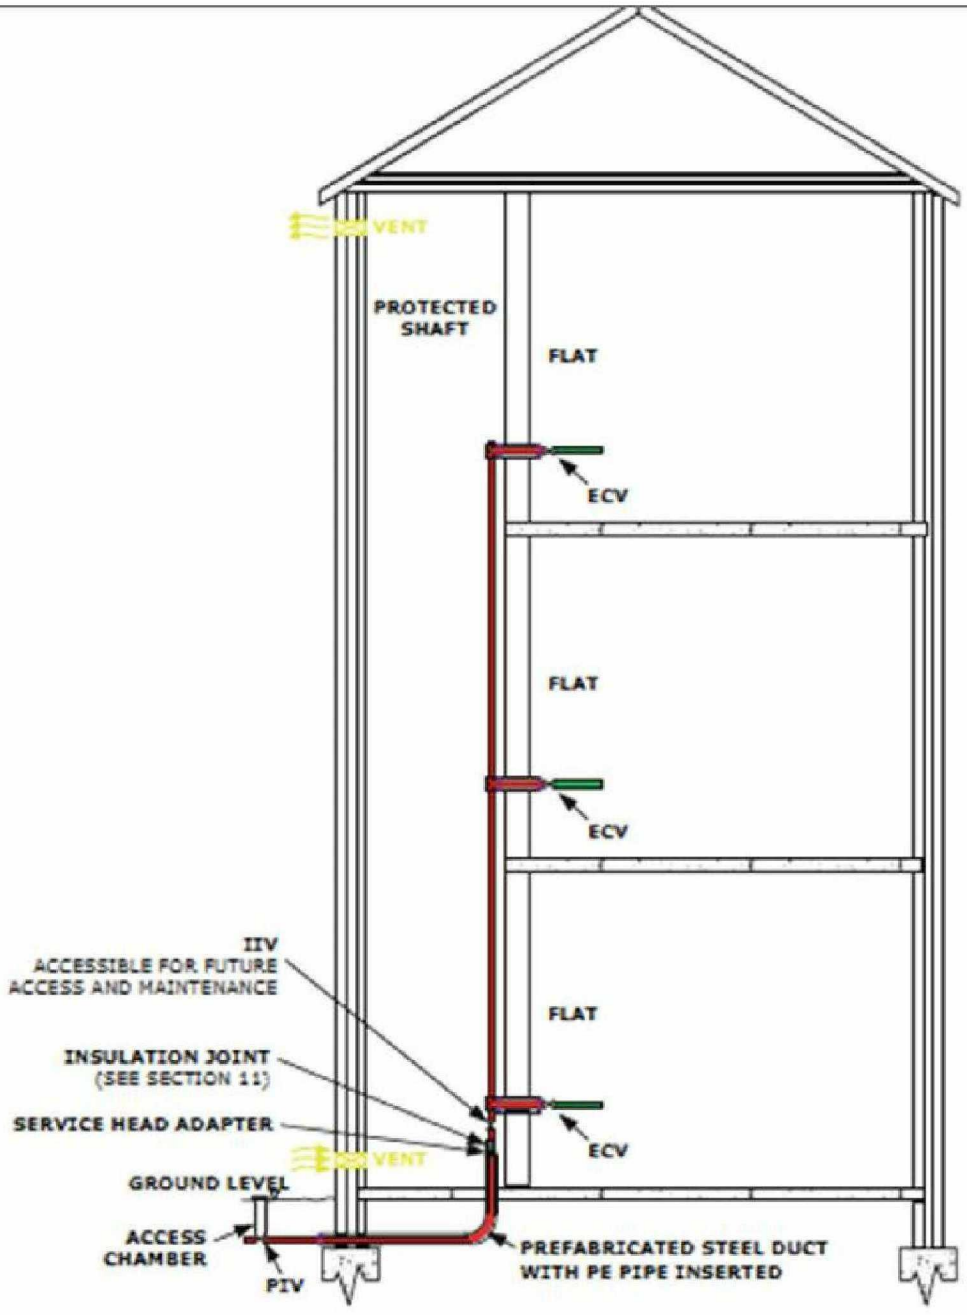

Note: Reference needs to be made to clause 4.2.1.4.

FIGURE 18 - INTERNAL SCREWED OR WELDED NETWORK PIPELINE. PASSING THROUGH A PROTECTED SHAFT (ON AN OUTSIDE WALL). VENTILATED DIRECTLY TO OUTSIDE AIR