

CONFIRMED
DECEMBER 2007

Fire performance of external cladding systems —

**Part 1: Test method for non-loadbearing
external cladding systems applied to
the face of the building**

WITHDRAWN

ICS 13.220.50

NO COPYING WITHOUT BSI PERMISSION EXCEPT AS PERMITTED BY COPYRIGHT LAW

BSi
British Standards

CTAR00000022/1
CTAR00000022/1

Committees responsible for this British Standard

The preparation of this British Standard was entrusted by Technical Committee FSH/22, Fire resistance tests, to a joint working group from Subcommittees FSH/21/7, Large and intermediate scale tests, and FSH/22/7, Test procedures for partitions, upon which the following bodies were represented:

Architectural and Specialist Door Manufacturers
 Association of Building Component Manufacturers Ltd.
 Association of Interior Specialists
 British Ceramic Research Ltd.
 British Plastics Federation
 British Rigid Urethane Foam Manufacturers' Association
 British Textile Technology Group
 BRE (Building Research Establishment)/LPC Laboratories
 External Wall Insulation Association
 EURISOL (UK Mineral Wool Association)
 European Phenolic Foam Association
 Fire Brigades Union
 Fire Resistant Glass and Glazing Federation
 Fire Safety Development Group
 Flat Glass Manufacturers' Association
 Gypsum Products Development Association
 Home Office
 IFS (Institute of Fire Safety)
 Institution of Structural Engineers
 Office of the Deputy Prime Minister (ODPM) (represented by the BRE)
 Office of the Deputy Prime Minister (ODPM) — Building Regulations Division
 RAPRA Technology Ltd.
 Timber Research and Development Association
 TIMSA Thermal Insulation Manufacturers
 UK Steel Association
 University College London
 University of Bath
 Warrington Fire Research Centre
 Co-opted members

This British Standard, having been prepared under the direction of the Health and Environment Sector Policy and Strategy Committee, was published under the authority of the Standards Policy and Strategy Committee on 13 December 2002

© BSI 13 December 2002

Amendments issued since publication

Amd. No.	Date	Comments

The following BSI references relate to the work on this British Standard:
 Committee reference FSH/21/7 and FSH/22/7
 Draft for comment 01/540504 DC

ISBN 0 580 40832 9

Contents

	Page
Committees responsible	Inside front cover
Foreword	ii
1 Scope	1
2 Terms and definitions	1
3 Principle	1
4 Test apparatus	2
5 Test specimen	5
6 Conditioning	6
7 Procedure	6
8 Post test examination	6
9 Test report	7
Annex A (normative) Calibration of the heat source	8
Annex B (normative) Timber crib source	10
Bibliography	13
Figure 1 — An example of the test facility	3
Figure 2 — Location of thermocouples for a cladding test	4
Figure A.1 — Location of heat flux meters and thermocouples for calibration test	9
Figure A.2 — Mean heat flux time profile for fuels other than cribs	10
Figure B.1 — Elevation and plan of the combustion chamber	11

Foreword

This British Standard has been prepared by a joint working group from Technical Committees FSH/21/7 and FSH/22/7 under the direction of FSH/22.

This British Standard was developed from an existing industry standard, BRE Fire Note 9 [published by the Building Research Establish (BRE)] [1], following a recommendation by the then House of Commons Environment, Transport and Regional Affairs Committee. This recommendation was contained within the committee's first report on the potential risk of fire spread in buildings via external cladding systems, which was published on 14 December 1999 (HC109) [2].

This part of BS 8414 has been produced to provide a test method for assessing the fire performance of non-loadbearing external cladding systems, rainscreen overcladding systems and external wall insulation systems at full-scale when applied to the face of a building and exposed to an external fire under controlled conditions. The fire exposure conditions have been developed to be representative of an external fire source or a fully-developed (post-flashover) fire in a room, venting through an opening such as a window aperture that exposes the cladding to the effects of external flames.

Further parts of this standard will be developed to cover the fire testing of curtain walling systems and systems that include glass panels.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, pages i to ii, pages 1 to 13 and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

1 Scope

This British Standard describes a method of assessing the behaviour of non-loadbearing external cladding systems, rainscreen overcladding systems and external wall insulation systems when applied to the face of a building and exposed to an external fire under controlled conditions. The fire exposure is representative of an external fire source or a fully-developed (post-flashover) fire in a room, venting through an opening such as a window aperture that exposes the cladding to the effects of external flames.

This British Standard does not cover the performance of glazed window openings or the detailing at such openings which are covered by separate tests. This British Standard does not apply to curtain walling systems or systems that include glass panels, the fire testing of which will be covered by further parts of this standard.

2 Terms and definitions

For the purposes of this British Standard the following terms and definitions apply.

2.1

external cladding system

complete cladding assembly, including, for example, sheeting rails, fixings, cavities, insulation and weathering membranes or coatings

2.2

face of the building

external plane of a continuous external wall of the building (usually of masonry construction), to which the cladding system is applied

2.3

level 1

height 2 500 mm above the top of the combustion chamber opening in the test apparatus

2.4

level 2

height 5 000 mm above the top of the combustion chamber opening in the test apparatus

2.5

start temperature, T_s

mean temperature of the thermocouples at level 1 during the 5 min prior to ignition of the heat source

2.6

start time, t_s

time when the temperature recorded by any external thermocouple at level 1 equals or exceeds a 200 °C temperature rise above T_s and remains above this value for at least 30 s

3 Principle

The external cladding system is applied to a vertical external masonry surface simulating the external face of a building in the form of a main face together with a return wing. The cladding system is applied in the manner specified by the test sponsor or vendor of the system. At the base of the main vertical masonry wall an opening is provided through which the fire can vent. A fully developed fire in a room abutting the external face of a building venting through a broken window is simulated. The extent of damage caused to the external cladding system, and in particular the ability for the external cladding system to resist the propagation of the fire upwards, is evaluated.

4 Test apparatus

4.1 Test facility

4.1.1 General

The test apparatus shall be representative of the face of a building and shall consist of a masonry, or masonry infill, structure with a vertical main test wall and a vertical return wall (wing) at 90° angles to, and at one side of the main test wall. The main wall shall be provided with a combustion chamber conforming to 4.1.4. The apparatus shall be capable of enduring the effects of the test procedure without itself suffering undue damage or distortion.

NOTE An example of a typical test apparatus is shown in Figure 1.

4.1.2 Main test wall, vertical, extending at least 6 000 mm above the top of the combustion chamber opening and at least 2 600 mm wide.

4.1.3 Return wall (wing), vertical, of the same height as the main test wall and having a minimum width of 1 500 mm. The wing shall be constructed perpendicular to the main test wall at a distance of (250 ± 10) mm from the side of the opening to the combustion chamber (see Figure 1).

4.1.4 Combustion chamber, positioned at the base of the main vertical test wall such that the fire can project through the opening at the base of the main vertical test wall. The opening shall be $(2\,000 \pm 100)$ mm high and $(2\,000 \pm 100)$ mm wide. The combustion chamber shall have a volume of at least 4.275 m³ and shall have internal dimensions of at least 1 900 mm wide, 1 000 mm deep and 2 250 mm high. A suitable heat source as specified in 4.1.5 shall be installed within the combustion chamber.

4.1.5 Heat source, conforming to the thermal performance requirements given in Annex A. The wooden crib described in Annex B has been found to meet the requirements of Annex A and can be used without conducting a calibration exercise. A calibration exercise shall be conducted in accordance with Annex A on all other heat sources such as gas burners.

4.2 Thermocouples

4.2.1 General

All thermocouples shall be Type K (Chromel/Alumel) mineral insulated 1.5 mm (nominal) diameter thermocouples with insulated junctions. At each specified level, temperatures shall be monitored using thermocouples placed in accordance with 4.2.2 and 4.2.3.


4.2.2 External thermocouples

4.2.2.1 General

External thermocouples shall be positioned to a tolerance of ± 10 mm with the hot junction positioned (50 ± 5) mm in front of the face of the system under investigation.

4.2.2.2 External thermocouples at level 1, positioned:

- on the main face of the façade, in positions on the centre line and at distances of 500 mm and 1 000 mm each side of the centre line (five locations);
- on the wing, at distances of 150 mm, 600 mm and 1 050 mm from the finished face of the cladding systems on the main face (three locations) (see Figure 2).

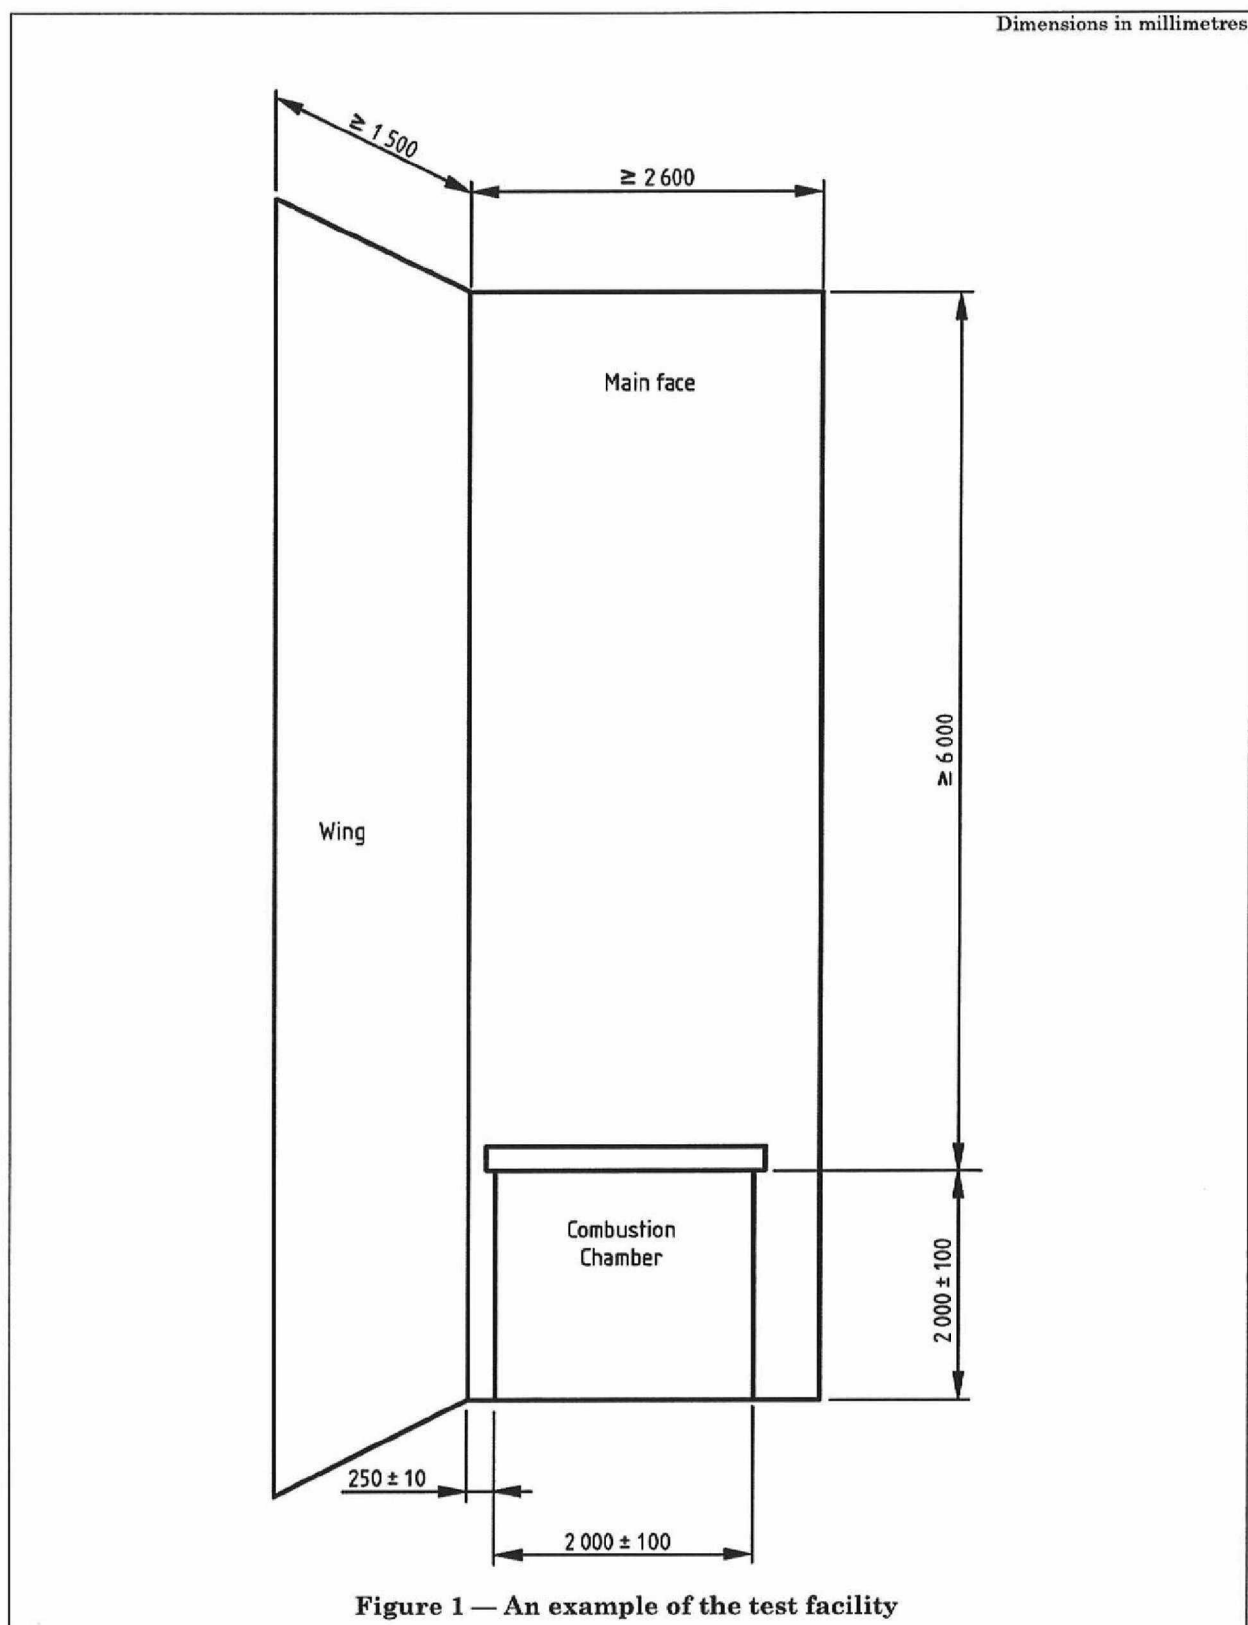

Dimensions in millimetres

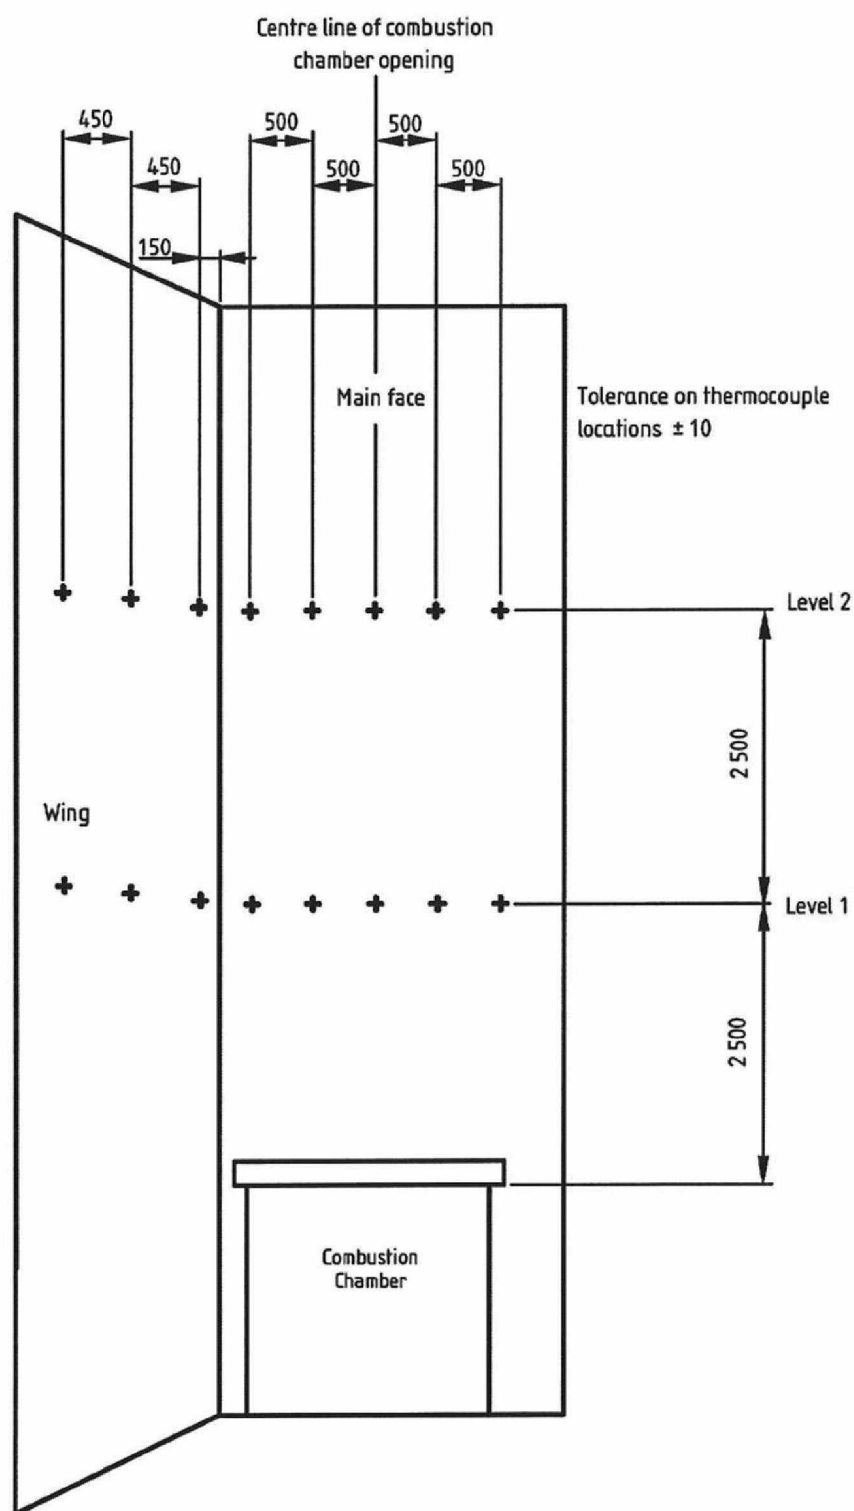


Figure 2 — Location of thermocouples for a cladding test

4.2.2.3 External thermocouples at level 2, positioned:

- on the main face of the façade, in positions on the centre line and at distances of 500 mm and 1 000 mm each side of the centre line (five locations);
- on the wing, at distances of 150 mm, 600 mm and 1 050 mm from the finished face of the cladding systems on the main face (three locations) (see Figure 2).

4.2.3 Internal thermocouples, positioned at level 2 to a tolerance of ± 10 mm. They shall be positioned at the mid-depth of each combustible layer. Thermocouples shall not be used for layers less than 10 mm thick. If the system contains cavities, thermocouples shall also be positioned at the mid-width of each cavity.

The internal thermocouples at level 2 shall be positioned:

- on the centre line of the main test face and at distances of 500 mm and 1 000 mm each side of the centre line (five locations); and
- on the wing at distances of 150 mm, 600 mm and 1 050 mm from the finished face of the cladding systems on the main face (three locations).

4.3 Data acquisition system, capable of recording data at a minimum of 10 s intervals, to which instruments shall be connected.

4.4 Audio visual equipment, capable of providing a visual record of the condition of the full height of the test faces at a minimum of 5 min intervals.

NOTE It is recommended that two cameras be used to cover the full height of both faces.

4.5 Ambient condition monitoring equipment, such as an anemometer with an accuracy of ± 0.5 m/s for measuring the ambient air velocity at a height of $(3\,000 \pm 100)$ mm above the ground.

4.6 Timing device, such as a clock, with an accuracy higher than 5 s/h.

5 Test specimen

5.1 General

The external cladding system shall include all relevant components assembled and installed in accordance with the manufacturer's instructions.

5.2 Dimensions of the cladding system

The maximum depth of the cladding system to be evaluated shall be 200 mm. On the main test wall the cladding system shall extend at least 2 400 mm horizontally from the corner of the test apparatus between the main wall and the wing. It shall extend from the top of the combustion chamber opening to a height of not less than 6 000 mm above the combustion chamber opening.

NOTE 1 The cladding system may extend down to the ground level on each side of the combustion chamber opening.

The cladding system shall not obstruct the combustion chamber opening.

On the wing of the test face the cladding system shall extend at least 1 200 mm horizontally from the corner of the test apparatus between the main wall face and the wing. It shall extend from the ground level to a height of not less than 6 000 mm above the combustion chamber opening.

The detail at the corner of the cladding system between the main wall face and wing shall abut or be constructed in accordance with the manufacturer's instructions.

Exposed edges and the perimeter of the combustion chamber opening shall be protected in accordance with the manufacturer's instructions.

NOTE 2 This may include a window frame without any glazing.

If the cladding system does not offer any protection to openings in practice, the interface between the cladding system and the combustion chamber shall also remain unprotected.

If horizontal joints are incorporated into the external wall cladding system, the cladding system shall incorporate horizontal joints at intervals specified by the manufacturer, with at least one joint placed $(2\,400 \pm 100)$ mm above the opening.

If vertical joints are incorporated into the external wall cladding system, the cladding system shall incorporate vertical joints at intervals specified by the manufacturer, with a joint extending upwards on the centre line of the combustion chamber opening, with a tolerance of ± 100 mm.

6 Conditioning

After application of the cladding system to the test facility, it shall be left to stand for a period of time which is sufficient for all components to cure correctly as specified by the manufacturer. If the test facility is unshielded from external weather conditions, it and the cladding system shall be protected from weather effects after the cladding system has been applied to it and before testing.

7 Procedure

7.1 Establishment of ambient conditions

The ambient temperature at the start of the test shall be within the range 20 ± 15 °C. The test shall not be conducted during fog or precipitation. The air velocity in any direction shall be less than 2 m/s at the start of the test.

7.2 Data acquisition

Commence the data acquisition and audio visual records at least 5 min prior to ignition of the fuel source. If, prior to ignition, more than two thermocouples at any level or in any layer yield unsatisfactory data testing shall be stopped.

7.3 Fuel source

At least 5 min after the start of the data acquisition, ignite the fuel source in the same way as determined in the calibration procedure described in Annex A. If the timber crib described in Annex B is used as the heat source, ignition shall be as described in Annex B.

7.4 Test observations

Record the times of significant events such as the change of flaming conditions and any change in the mechanical behaviour of the cladding system, especially the detachment of any part of the cladding system.

The nominal duration of the burning of the heat source shall be 36 min. If any part of the cladding system is still burning 30 min after ignition of the heat source continue taking records for a maximum time of 60 min. Otherwise, terminate the test 30 min after the ignition of the heat source.

8 Post test examination

Examine the cladding system when cooled (within 24 h of the test) for damage, such as spalling, melting, deformation and delamination but not smoke staining or discolouration, ensuring that the following features are included and recorded in the examination (some dismantling of the system may be necessary):

- a) the extent of flame spread over the surface of the cladding system (both vertically and horizontally);
- b) the extent of flame spread and damage within any intermediate layers (both vertically and horizontally);
- c) an estimate of any flame spread and damage within the cavity, if present, (both vertically and horizontally);
- d) the extent to which the external face of the cladding system has burnt away or become detached;
- e) the details of any collapse or partial collapse of the cladding system.

9 Test report

The test report shall include the following information:

- a) the test date;
- b) details of the test sponsor;
- c) a full description of the cladding system, together with details of materials and components used;
- d) details of the apparatus used;
- e) details of the result of the test as described in Clause 8;
- f) a record of visual observations made during the test including flaming and mechanical response supplemented by suitable photographic records (see 7.4);
- g) ambient conditions;
- h) the temperature profiles recorded at each level during the test.

NOTE When plotting the temperature profiles the origin of the time axis should be the start time, t_0 .

Annex A (normative)

Calibration of the heat source

A.1 Principle

A calibration exercise is carried out on a non-combustible façade of calcium silicate board nominally 12 mm thick with a density of (850 ± 50) kg/m³ placed vertically against the external face of the main vertical test wall immediately above the opening.

A.2 Apparatus

A.2.1 Thermocouples

A.2.1.1 General

Thermocouples shall be Type K (Chromel/Alumel) mineral insulated 1.5 mm (nominal) diameter thermocouples with insulated junctions.

A.2.1.2 Three thermocouples in the combustion chamber, positioned (50 ± 10) mm below the top of the combustion chamber opening, (100 ± 10) mm behind the plane of the front face of the calibration boards. One thermocouple shall be positioned on the centre line of the combustion chamber opening, and the other two thermocouples shall be displaced (900 ± 10) mm either side of the centre line.

A.2.1.3 Five thermocouples at level 1, positioned to a tolerance of ± 10 mm with the hot junction positioned (50 ± 5) mm in front of the face of the calibration boards at level 1. These shall be located on the centre line and at distances of 500 mm and 1 000 mm each side of the centre line (see Figure A.1)

A.2.2 Three Gardon type total heat flux meters, with nominal size of 2.5–5 cm, with a measuring range $(0\text{--}100)$ kW/m², placed $(1\,000 \pm 100)$ mm above the chamber opening. These shall be located on the vertical centre line of the combustion chamber opening and (500 ± 10) mm either side (see Figure A.1). The measuring element of the heat flux meter shall correspond to the face of the calibration board exposed to the heat source.

A.3 Procedure

A.3.1 General

Follow the test procedure in Clause 7.

A.3.2 Temperature

A.3.2.1 Combustion chamber

The temperature across the width of the combustion chamber opening shall be monitored by the three thermocouples located as shown in Figure A.1. The mean reading of the three thermocouples shall exceed a 600 °C temperature rise above the start temperature, T_s , over a continuous 20 min period. The variation between the mean temperature reading and any one thermocouple over the 20 min monitoring period shall not exceed ± 20 °C.

A.3.2.2 Level 1


The mean temperature of thermocouples A, B and C shown on Figure A.1, at level 1 on the main face, shall exceed a temperature rise of 500 °C above T_s over a continuous 20 min period.

A.3.3 Heat flux

For fuel sources other than wood cribs, the mean heat flux measurement shall follow the profile exhibited in Figure A.2 and shall remain within the range of $(45\text{--}95)$ kW/m² over a continuous 20 min period.

A.3.4 Duration

The nominal duration of the entire heating period shall be 36 min.

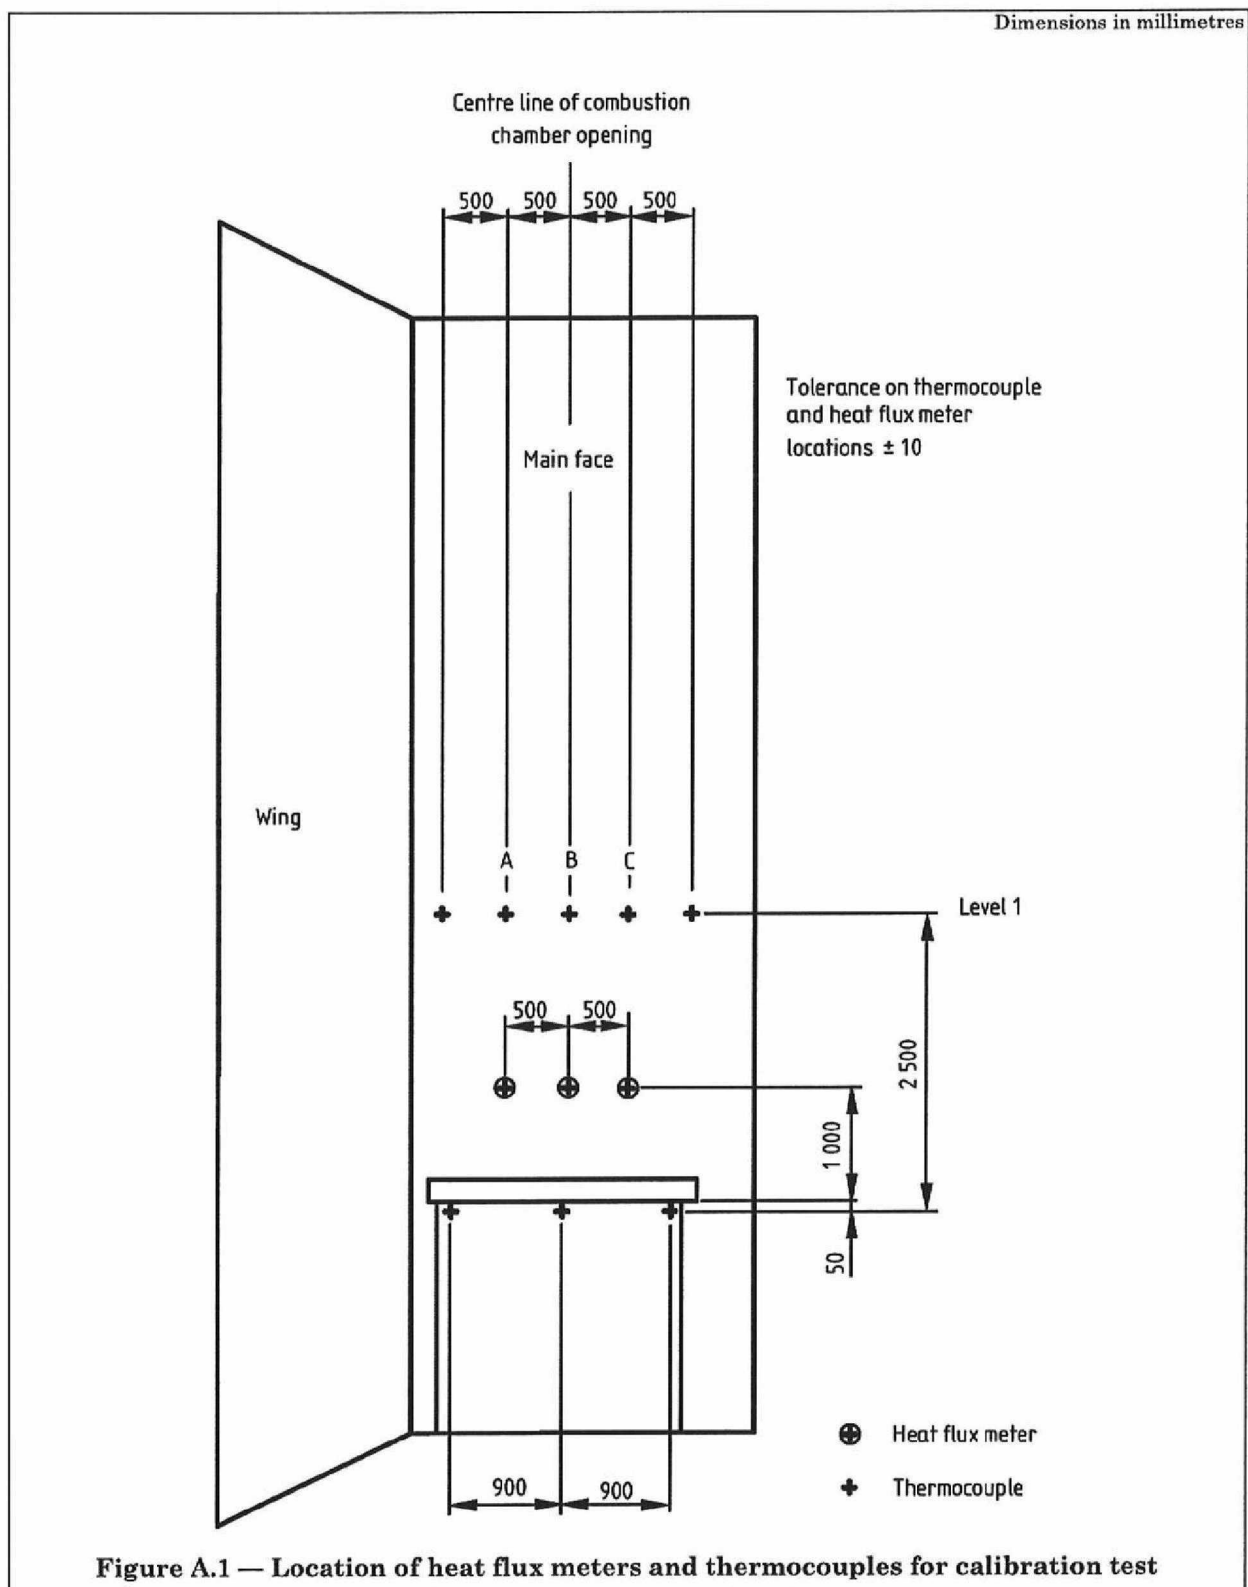

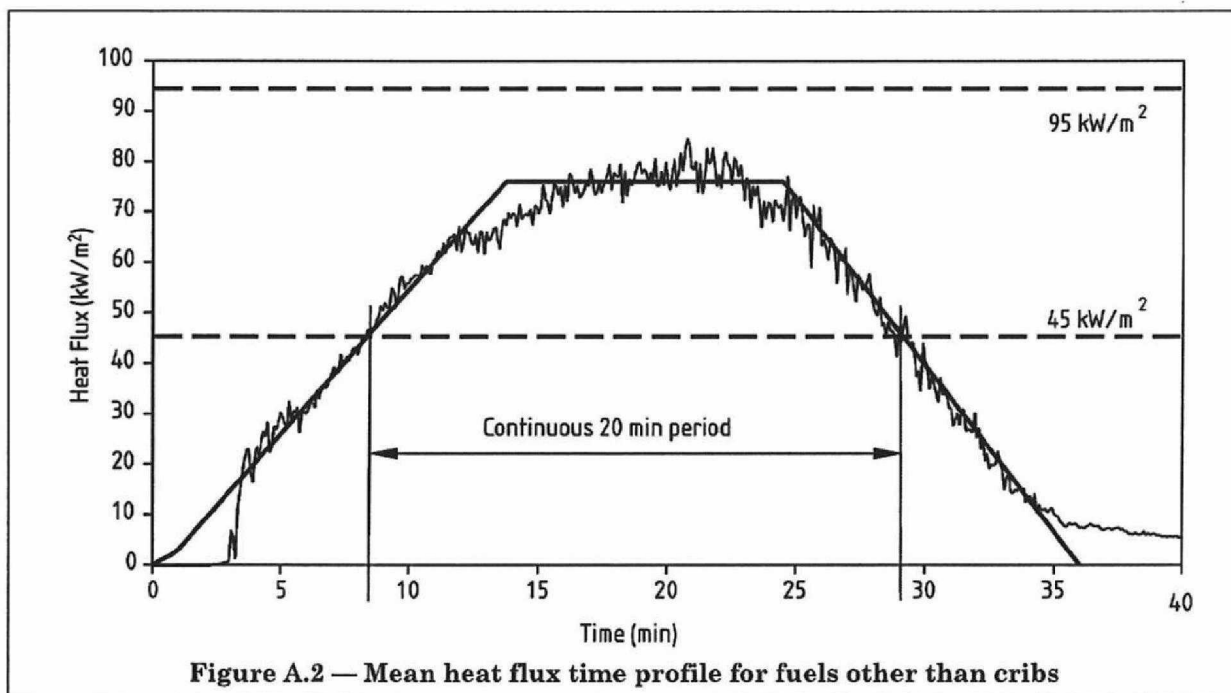


Figure A.2 — Mean heat flux time profile for fuels other than cribs

Annex B (normative)

Timber crib source

NOTE The heat source described in this Annex has been found to meet the criteria of Annex A and may be used without the need for any calibration exercise.

B.1 Apparatus

B.1.1 *Softwood sticks*, with nominal dimensions of 50 mm × 50 mm cross-section and nominal lengths of 1 500 mm and 1 000 mm. At the time of test the softwood shall have a moisture content in the range of 10 % to 16 % by mass.

B.1.2 *16 strips of low density fibreboard*, having nominal dimensions of (25 × 12 × 1 000) mm.

B.2 Procedure

B.2.1 Construct a timber crib nominally 1 500 mm × 1 000 mm in plane and 1 000 mm high of softwood sticks.


Construct the crib of alternate layers of long and short sticks, with the first layer consisting of 10 1 500 mm long sticks. The next layer shall consist of 15 short sticks evenly distributed to cover an area of 1 500 mm × 1 000 mm.

Repeat this process to give a total of 20 layers of sticks giving it a nominal height of 1 000 mm. In total use 150 short sticks and 100 long sticks.

B.2.2 Construct the crib on a solid platform positioned (400 ± 50) mm above the floor of the combustion chamber. Locate the crib centrally in the combustion chamber and displaced (100 ± 10) mm from the back wall of the chamber (see Figure B.1).

B.2.3 Ignite the crib using 16 strips of low density fibreboard. Soak the strips uniformly for a minimum of 5 min with 5 l of white spirit. Not more than 5 min before ignition, insert 14 strips into the spaces between the timber sticks in the second layer of the crib (i.e. 50 mm above the platform) allowing approximately 30 mm to project from the front of the crib. Place the remaining two strips horizontally across the 14 projected strip ends. Ignite only these two horizontal strips across their full length.

NOTE This heat source releases a nominal total heat output of 4 500 MJ over 30 min at a peak rate of (3 ± 0.5) MW.

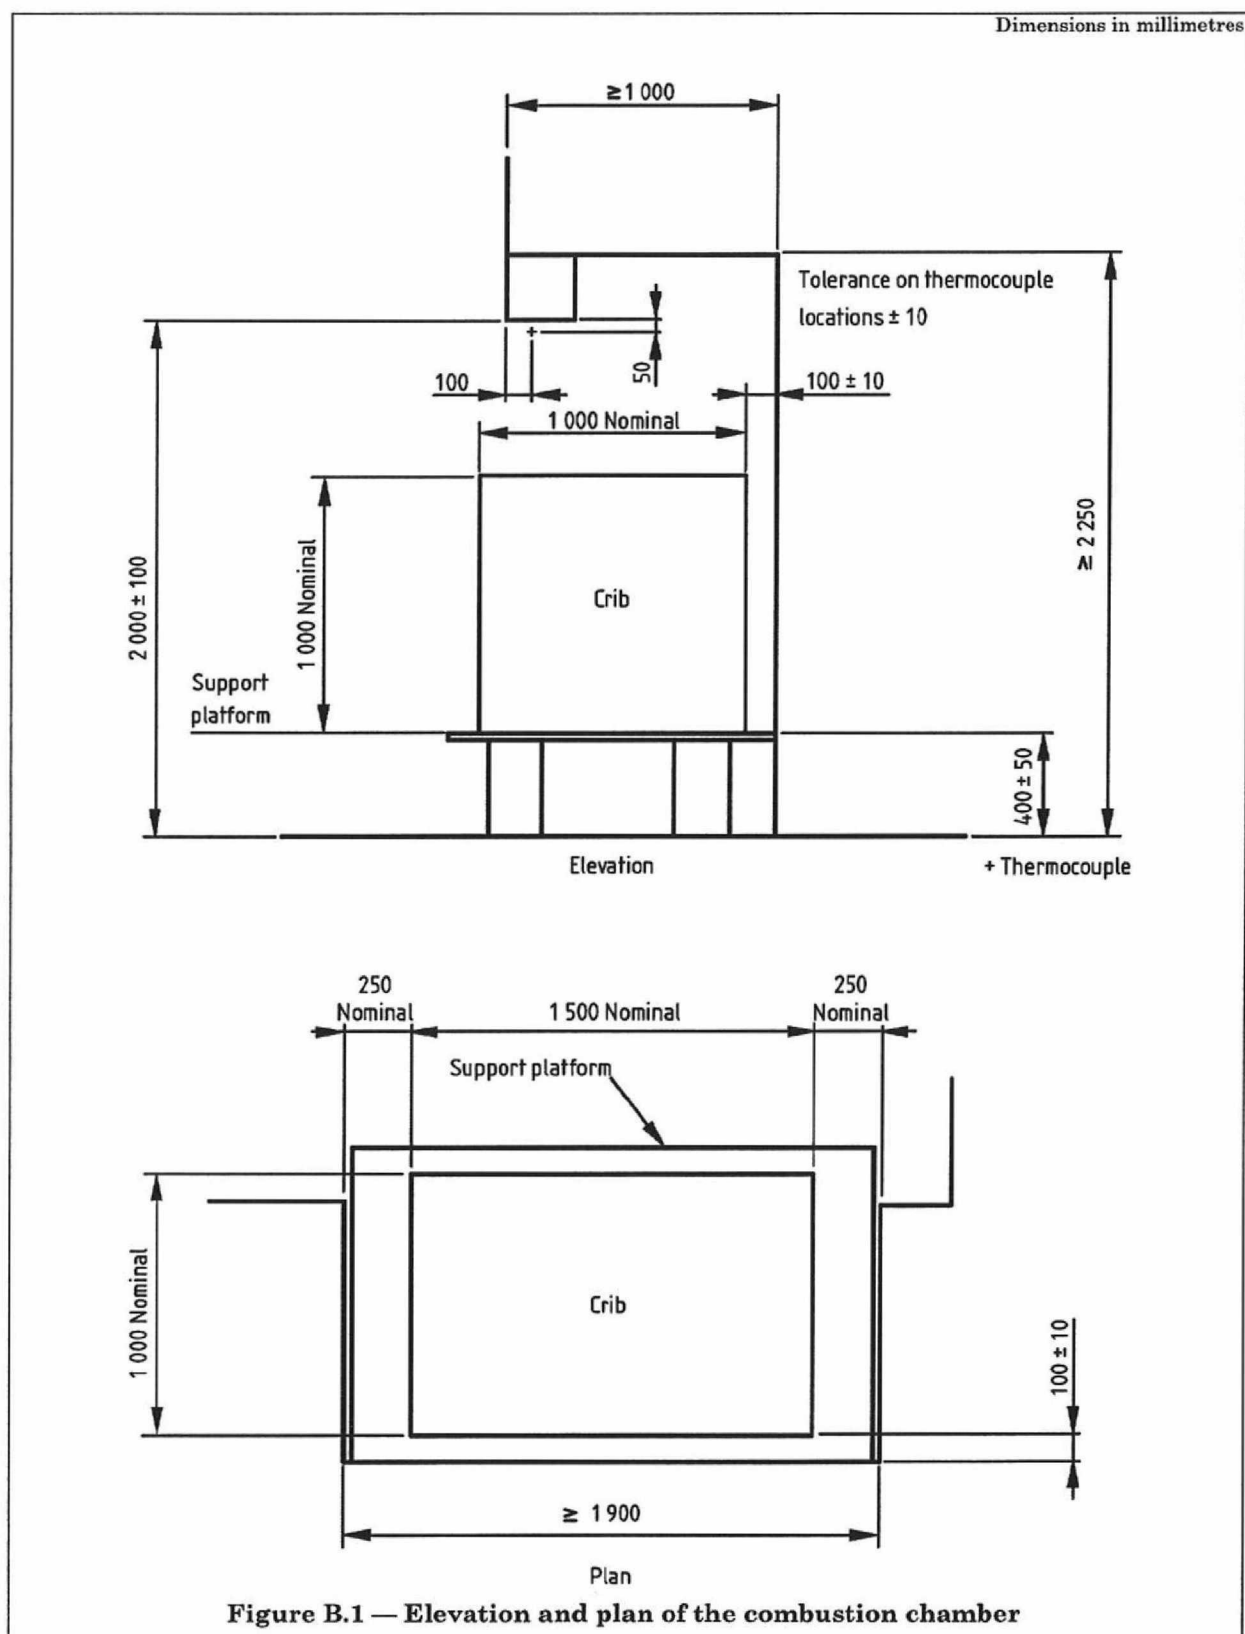

Bibliography

- [1] COLWELL, S.A, and D.J. SMIT. *Assessing the fire performance of external cladding systems: a test method. Fire Note 9 (FN9)*. London: Building Research Establishment (BRE) and CRC.
- [2] GREAT BRITAIN. Parliament. House of Commons Environment, Transport and Regional Affairs Committee (Bennett, A.F.). 1st report, session 1999-00. *Potential risk of fire spread in buildings via external cladding systems — Report and proceedings of the Committee*. House of Commons papers 1999-00 109. January 2000. London: The Stationery Office.

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.
Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001.
Fax: +44 (0)20 8996 7001. Email: orders@bsi-global.com. Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.
Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: info@bsi-global.com.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.
Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001.
Email: membership@bsi-global.com.

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager.
Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553.
Email: copyright@bsi-global.com.

BSI
389 Chiswick High Road
London
W4 4AL

Fire performance of external cladding systems —

**Part 2: Test method for non-loadbearing
external cladding systems fixed to and
supported by a structural steel frame**

WITHDRAWN

ICS 13.220.50

Confirmed
December 2011

NO COPYING WITHOUT BSI PERMISSION EXCEPT AS PERMITTED BY COPYRIGHT LAW

BSi
British Standards

Committees responsible for this British Standard

The preparation of this British Standard was entrusted by Technical Committee FSH/21, Reaction to fire tests and Technical Committee FSH/22, Fire resistance tests, to a joint working group from Subcommittees FSH/21/7, Large and intermediate scale tests, and FSH/22/7, Text procedures for partitions, upon which the following bodies were represented:

Architectural and Specialist Door Manufacturers
 Association of Building Component Manufacturers Ltd.
 Association of Interior Specialists
 British Plastics Federation
 British Rigid Urethane Foam Manufacturers' Association
 British Textile Technology Group
 BRE (Building Research Establishment)/LPC Laboratories
 Ceram Research Ltd.
 Engineered Panels in Construction
 EURISOL (UK Mineral Wool Association)
 European Phenolic Foam Association
 Fire Brigades Union
 Fire Safety Development Group
 Flat Glass Manufacturers' Association
 Gypsum Products Development Association
 IFS (Institute of Fire Safety)
 Office of the Deputy Prime Minister (ODPM) (represented by the BRE)
 Office of the Deputy Prime Minister (ODPM) — Building Regulations Division
 RAPRA Technology Ltd.
 TIMSA Thermal Insulation Manufacturers
 UK Steel Association
 University College London
 University of Bath
 Warrington Fire Research Centre
 Co-opted members

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 6 October 2005

© BSI 6 October 2005

Amendments issued since publication

Amd. No.	Date	Comments

The following BSI references relate to the work on this standard:
 Committee reference FSH/22/7
 Draft for comment
 04/30107486 DC

ISBN 0 580 46754 6

Contents

	Page
Committees responsible	Inside front cover
Foreword	ii
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Principle	2
5 Test apparatus	2
6 Test specimen	6
7 Conditioning	7
8 Procedure	7
9 Post-test examination	7
10 Test report	8
Annex A (normative) Structural steel test frame	9
Annex B (normative) Calibration of the heat source	11
Annex C (normative) Timber crib source	14
Bibliography	17
Figure 1 — Schematic of test apparatus	3
Figure 2 — Location of thermocouples for a cladding test	5
Figure A.1 — Steel test frame	10
Figure B.1 — Location of heat flux meters and thermocouples for calibration test	12
Figure B.2 — Mean heat flux time profile for fuels other than cribs	14
Figure C.1 — Elevation and plan of the combustion chamber	16
Table A.1 — Section details	9

Foreword

This British Standard has been prepared by a joint working group from Technical Committees FSH/21/7 and FSH/22/7 under the direction of FSH/21 and FSH/22.

This British Standard was developed from BRE Fire Note 9 [1], following a recommendation by the then House of Commons Environment, Transport and Regional Affairs Committee on the potential risk of fire spread in buildings via external cladding systems [2].

BS 8414, *Fire performance of external cladding systems*, consists of the following parts:

- *Part 1: Test method for non-loadbearing external cladding systems applied to the face of a building; and*
- *Part 2: Test method for non-loadbearing external cladding systems fixed to and supported by a structural steel frame.*

WARNING This British Standard calls for the use of substances and/or procedures that may be injurious to health if adequate precautions are not taken. It refers only to technical suitability and does not absolve the user from legal obligations relating to health and safety at any stage.

A British Standard does not purport to include all necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, pages i and ii, pages 1 to 17 and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

1 Scope

This British Standard provides a test method for assessing the behaviour of non-loadbearing external cladding systems, such as curtain walling, glazed elements, infill panels and insulated composite panels, fixed to and supported by a structural steel frame when exposed to a fully-developed (post-flashover) fire in a room, venting through an opening such as a window aperture that exposes the cladding to the effects of external flames, or from an external fire source.

This method of test does not apply to non-loadbearing external rainscreen overcladding systems or external wall insulation systems applied to the face of a building, the fire testing of which are covered in BS 8414-1. This test does not cover exposure to radiant heat from a fire in an adjacent building.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the reference cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

BS EN ISO 13943, *Fire safety — Vocabulary*.

3 Terms and definitions

For the purposes of this British Standard, the terms and definitions given in BS EN ISO 13943 and the following apply.

3.1

collapse

any part of the cladding system which falls away and becomes detached

3.2

combustible layer

layer incorporated in the construction product which, if tested in isolation, would fail the non-combustibility definition in Approved Document B:2004 [3]

3.3

damaged area

total of those surface areas which have been affected permanently by fire under specified conditions

NOTE 1 It is expressed in square metres.

NOTE 2 Users of this term should specify the types of damage to be considered. This could include, for example, loss of material, deformation, softening, melting, charring, combustion, pyrolysis or chemical attack.

NOTE 3 This definition is taken from BS EN ISO 13943.

3.4

external cladding system

complete cladding assembly

NOTE This includes, for example, sheeting rails, fixings, cavities, insulation and weathering membranes, coatings, flashings or joints.

3.5

level 1 height

2 500 mm above the top of the combustion chamber opening in the test apparatus

3.6

level 2 height

5 000 mm above the top of the combustion chamber opening in the test apparatus

3.7

start temperature

T_s

mean temperature of the thermocouples at level 1 height during the five minutes prior to ignition of the heat source

3.8

start time

 t_s

time when the temperature recorded by any external thermocouple at level 1 height equals or exceeds a 200 °C temperature rise above T_s and remains above this value for at least 30 s

4 Principle

The test method simulates a fully developed fire in a room abutting the external face of a building and venting through an aperture. In this test, the external cladding system is fixed to, and supported by, a structural steel frame, so as to simulate the external face of a building in the form of a main face together with a return wing, with the cladding system attached in the manner specified by the test sponsor. At the base of the vertical system, an opening is provided through which the fire can vent.

The extent of damage caused to the external cladding system is evaluated, particularly the ability of the external cladding system to resist the propagation of the fire upwards. Any falling debris and fire penetration from the external to internal face should also be assessed.

5 Test apparatus

5.1 Test facility

5.1.1 General. The test apparatus shall utilize a vertical structural steel frame (5.1.2), representative of a structural steel framed building, with a vertical main test wall and a vertical return wall (wing) at 90° angles to, and at one side of the main test wall. The main wall shall be provided with a combustion chamber conforming to 5.1.5. The apparatus shall be capable of enduring the effects of the test procedure without itself suffering undue damage or distortion.

NOTE An example of a typical test apparatus is shown in Figure 1.

5.1.2 Test frame, conforming to the requirements detailed in Annex A.

5.1.3 Main wall. The vertical main wall shall extend at least 6.0 m above the top of the combustion chamber opening and shall be at least 2.8 m wide.

5.1.4 Return wall (wing). The vertical return wall (wing) shall be the same height as the main test wall and have a minimum width of 1 500 mm. The wing shall be constructed perpendicular to the main test wall to allow a distance of 260^{0}_{-100} mm from the side of the opening on a finished face to the combustion chamber (see Figure 1).


5.1.5 Combustion chamber, positioned at the base of the main vertical test wall such that the fire can project through the opening at the base of the main vertical test wall. The top of the chamber opening shall be $(2\,000 \pm 100)$ mm above the base of the test facility and shall be $(2\,000 \pm 100)$ mm wide. The combustion chamber shall be capable of enduring the effects of the test procedure without itself suffering undue damage or distortion. The chamber shall be constructed in accordance with the dimensions shown in Figure C.1, including the provision of a robust lintel across the head of the chamber opening and a suitable solid platform to support the heat source. A suitable heat source as specified in 5.2 shall be installed within the combustion chamber.

5.2 Heat source

The heat source shall:

- a) be calibrated in accordance with Annex B; or
- b) be as specified in Annex C.

NOTE The wooden crib described in Annex C has been found to meet the requirements of Annex B and may be used without conducting a calibration exercise. A calibration exercise needs to be conducted in accordance with Annex B on all other heat sources such as gas burners.

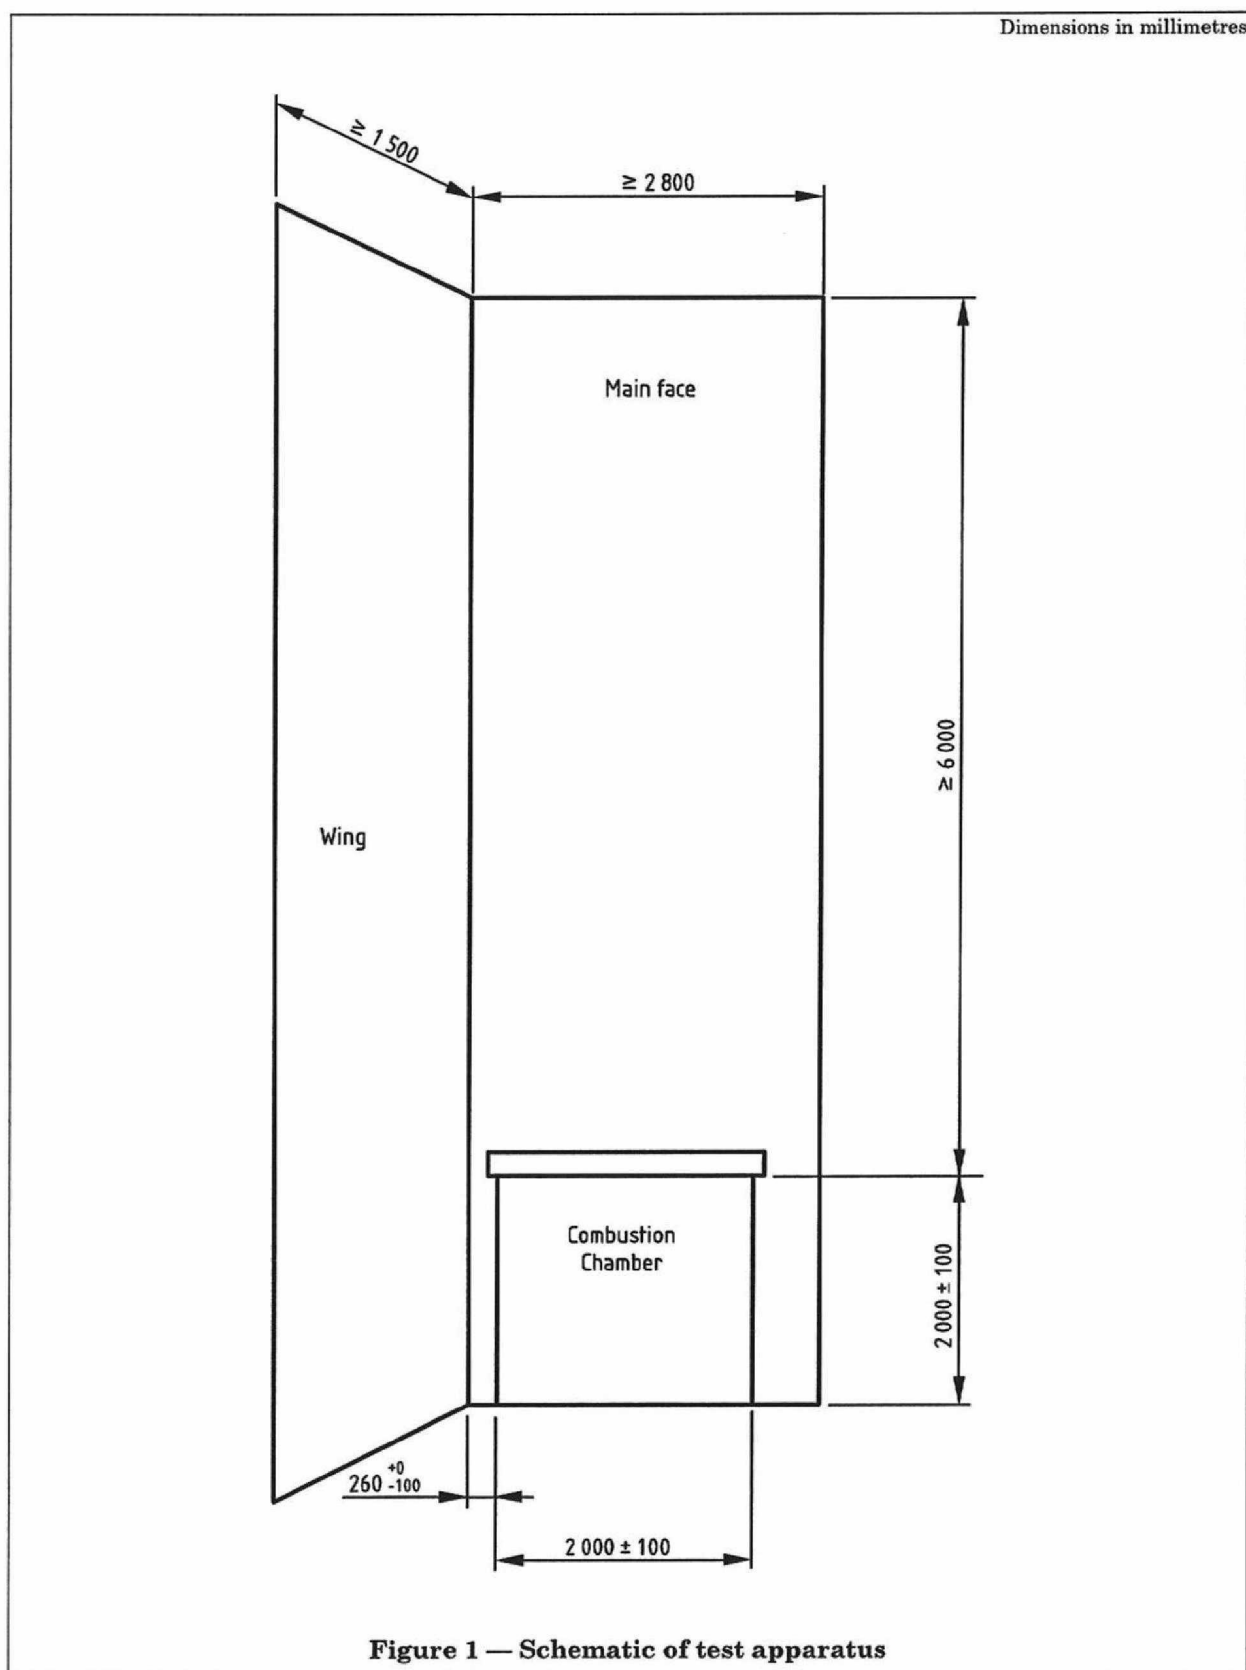

5.3 Thermocouples

5.3.1 General

All thermocouples shall be mineral insulated 1.5 mm (nominal) diameter thermocouples of Type K (Chromel/Alumel) with insulated junctions. At each specified level, temperatures shall be monitored using thermocouples placed in accordance with 5.3.2 and 5.3.3.

5.3.2 External thermocouples

5.3.2.1 General

External thermocouples shall be positioned to a tolerance of ± 10 mm with the hot junction positioned (50 ± 5) mm in front of the face of the system under investigation.

5.3.2.2 Position of external thermocouples at level 1 height


External thermocouples shall be located at level 1 height on:

- a) the main face of the façade, in positions on the centre line of the combustion chamber opening, and at distances of 500 mm and 1 000 mm each side of the centre line (five locations); and
- b) the side wing, at distances of 150 mm, 600 mm and 1 050 mm from the finished face of the cladding system on the main face (three locations) (see Figure 2).

5.3.2.3 Position of external thermocouples at level 2 height

External thermocouples shall be located at level 2 height on:

- a) the main face of the façade, in positions on the centre line of the combustion chamber opening and at distances of 500 mm and 1 000 mm each side of the centre line of the combustion chamber opening (five locations);
- b) the wing, at distances of 150 mm, 600 mm and 1 050 mm from the finished face of the cladding systems on the main face (three locations) (see Figure 2).

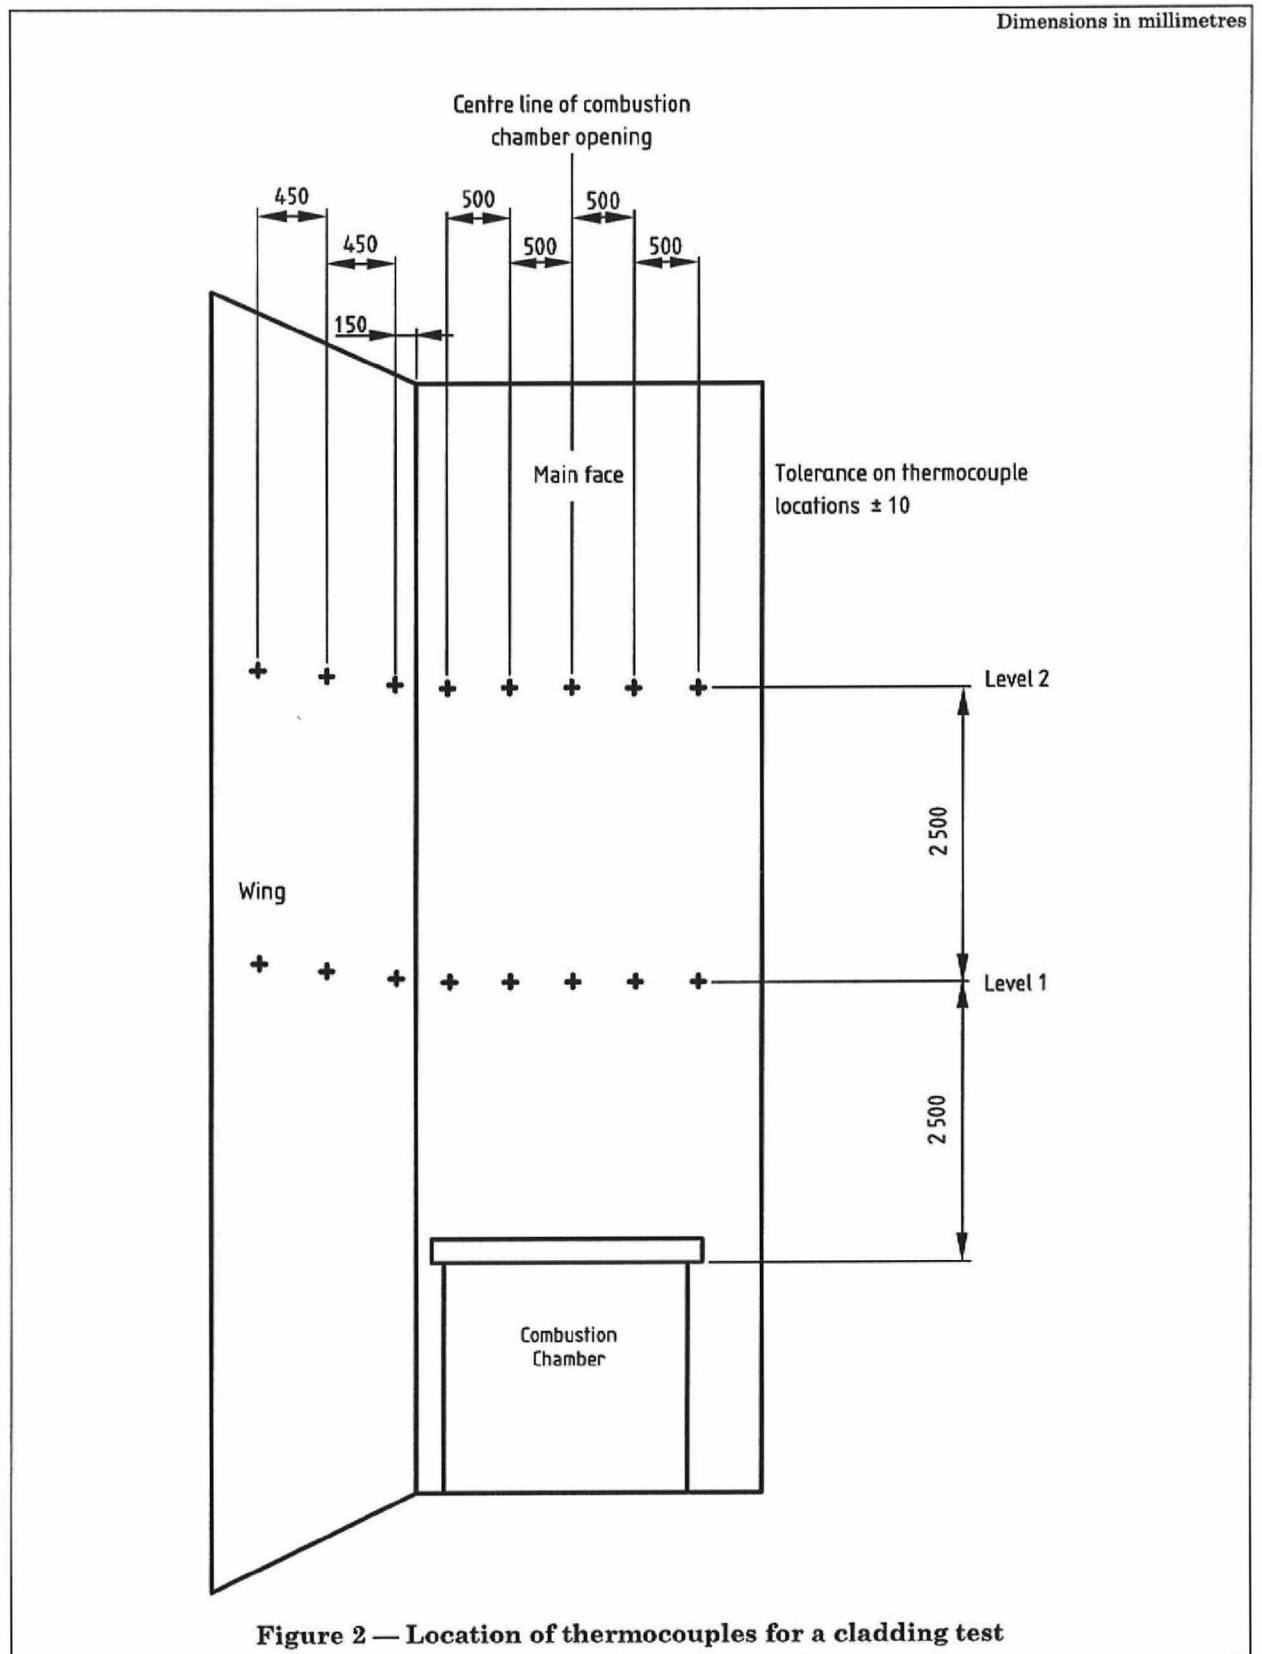

5.3.3 Internal thermocouples

Internal thermocouples shall be positioned at level 2 height to a tolerance of ± 10 mm. They shall be positioned at the mid-depth of each combustible layer (see 3.2).

Thermocouples shall not be used for layers less than 10 mm thick. If the system contains cavities, thermocouples shall also be positioned at the mid-width of each cavity. Sealed cavities, such as those found in glazing systems shall not be broken and, therefore, no measurements can be taken.

The internal thermocouples at level 2 height shall be positioned:

- a) on the centre line of the main test face and at distances of 500 mm and 1 000 mm each side of the centre line (five locations); and
- b) on the wing at distances of 150 mm, 600 mm and 1 050 mm from the finished face of the cladding systems on the main face (three locations).

5.4 Data acquisition system

A data acquisition system capable of recording data at minimum intervals of 10 s shall be connected to the instruments.

5.5 Audio visual equipment

Video equipment shall be capable of providing a visual record of the condition of the full height of the test faces at a minimum of five minute intervals. Both the internal and external faces of the test specimen shall be monitored.

NOTE It is recommended that four cameras be used to cover the full height of both faces, both internally and externally.

5.6 Ambient condition monitoring equipment

Equipment for monitoring wind speed such as an anemometer shall have an accuracy of ± 0.5 m/s for measuring the ambient air velocity at a height of $(3\,000 \pm 100)$ mm above the ground and another $(1\,000 \pm 10)$ mm from the centre line of the combustion chamber.

5.7 Timing device

The timing device used, such as a clock, shall have an accuracy better than 5 s/h.

6 Test specimen

6.1 General

The external cladding system shall include all relevant components assembled and installed in accordance with the instructions of the test sponsor, in particular paying attention to 6.2.

6.2 Dimensions of the cladding system

The cladding system shall be constructed in accordance with the instructions of the test sponsor and shall be representative of end use installation, including corner and edge finishing details.

NOTE The maximum thickness of the system is effectively limited only by the relevant frame design. See Annex A.

The cladding system shall extend horizontally from the finished corner of the test sample, at least 2.4 m on the main test face and at least 1.2 m on the wing. The system shall extend from the base of the test facility to a height of at least 6.0 m above the top of the combustion chamber opening on both faces. The cladding system shall not obstruct the combustion chamber opening.

If the cladding system does not offer any protection around openings such as windows and doorways in practice, the interface between the cladding system and the combustion chamber shall also remain unprotected.

If horizontal joints are incorporated into the external wall cladding system, the cladding system shall incorporate horizontal joints at intervals specified by the test sponsor, with at least one joint placed $(2\,400 \pm 100)$ mm above the opening.

If vertical joints are incorporated into the external wall cladding system, the cladding system shall incorporate vertical joints at intervals specified by the test sponsor, with a joint extending upwards on the centre line of the combustion chamber opening, with a tolerance of ± 100 mm.

7 Conditioning

After application of the cladding system to the test facility, it shall be left to stand for a period of time sufficient for all components to cure correctly as specified by the test sponsor. If the test facility is unshielded from external weather conditions, it and the cladding system shall be protected from weather effects after the cladding system has been applied to it and before testing.

8 Procedure

8.1 Environmental test conditions

The ambient temperature at the start of the test shall be within the range $(20 \pm 15) ^\circ\text{C}$. The test shall not be conducted during fog or precipitation. The air velocity in any direction shall be less than 2 m/s at the start of the test.

8.2 Data acquisition

Commence the data acquisition and audio visual records at least five minutes prior to ignition of the fuel source. If, prior to ignition, more than two thermocouples at any level or in any layer yield unsatisfactory data, testing shall be stopped.

8.3 Fuel source

At least five minutes after the start of the data acquisition, ignite the fuel source in the same way as determined in the calibration procedure defined in Annex B. If the timber crib described in Annex C is used as the heat source, ignition shall be as described in Annex C.

8.4 Test observations

Record the times of significant events such as the change of flaming conditions and any change in the mechanical behaviour of the cladding system, especially the detachment of any part of the cladding system (whether flaming or otherwise) or any fire penetrations through fire stops incorporated within the cladding system.

8.5 Test termination criteria

Extinguish the heat source 30 min after ignition. If no part of the cladding system is still burning, terminate the test. If flaming or monitored temperatures are still rising, continue taking records for an additional 30 min, up to maximum test duration of 60 min. (See C.2.4.)

The test shall also be terminated:

- a) if flame spread extends above the test facility; or
- b) if there is a risk to the safety of personnel or impending damage to equipment.

9 Post-test examination

Examine the cladding system when cooled (within 24 h of the test) for damage, such as spalling, melting, deformation and delamination, but not smoke staining or discolouration, ensuring that the following features are included and recorded in the examination (some dismantling of the system might be necessary):

- a) extent of flame spread over the surface of the cladding system;
- b) extent of flame spread and/or damaged areas within any intermediate layers;
- c) estimate of any flame spread and/or damaged areas within the cavity, if present;
- d) extent to which the external face of the cladding system has burnt away or become detached;
- e) details of any collapse or partial collapse of the cladding system (see 3.1).

10 Test report

The test report shall include the following information:

- a) details of this British Standard, i.e. BS 8414-2:2005;
- b) the test date;
- c) details of the test sponsor;
- d) full description of the cladding system, together with details of materials and components used and fixing details;
- e) details of the apparatus used, including full details of the test frame with a complete description of the installation and fixing methods used to install the system;
- f) ambient conditions;
- g) record of visual observations made during the test including flaming and mechanical response supplemented by suitable photographic records (see 8.4);
- h) temperature profiles recorded at each level during the test;

NOTE When plotting the temperature profiles, the origin of the time axis should be the start time, t_s .

- i) details of the results of the test, including post-test examination, as described in Clause 9.

Annex A (normative)

Structural steel test frame

The test frame shall be designed and constructed to withstand the expected loading imposed by the system under test and any subsequent distortions that can occur during the test programme.

NOTE 1 A specifically designed test frame might be needed.


NOTE 2 Figure A.1 shows a typical structural steel test frame. The test specimen installation might need modification of, or additions to, an existing base test frame.

Figure A.1 shows a typical test frame design.


Table A.1 — Section details

Section reference	Nominal detail	Mass per unit length kg/m
A	254 × 146 × 11 Universal beam	37.0
B	150 × 150 × 6.3 Steel hollow section	28.3
C	127 × 64 × 9 Pre-formed channel	14.9
D	80 × 80 × 6 Rolled steel angle	9.63


All dimensions are nominal




Section A




Section B




Section C




Section D

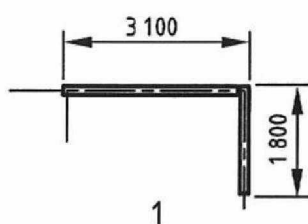

1

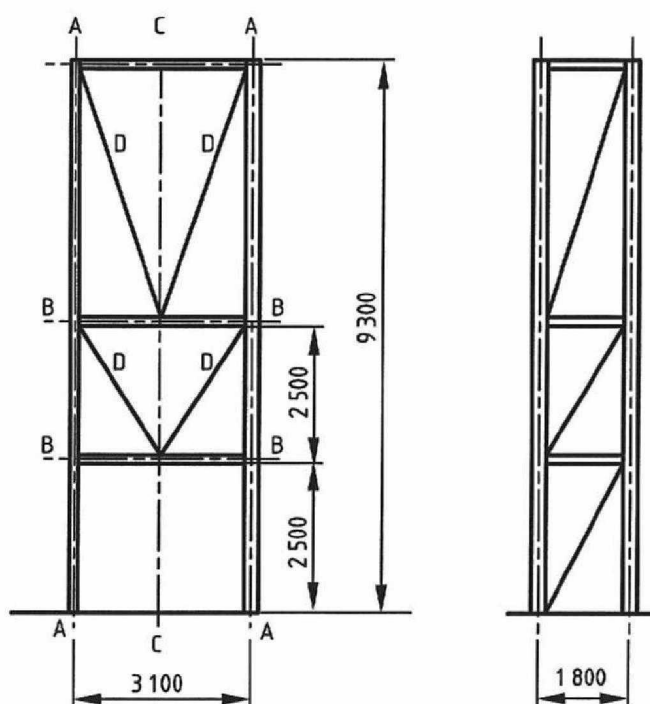

2

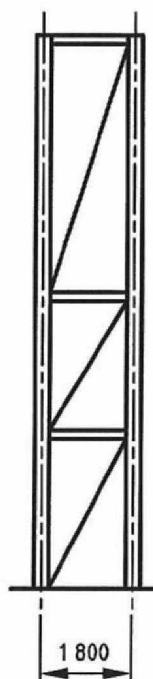

3

Key

- 1 Plan
- 2 Front elevation
- 3 Side elevation

NOTE Details of the steel sections are provided in Table A.1.

Figure A.1 — Steel test frame

Annex B (normative)

Calibration of the heat source

B.1 Principle

A calibration exercise is carried out on a non-combustible façade of calcium silicate board, nominally 12 mm thick with a density of $(850 \pm 50) \text{ kg/m}^3$, placed vertically against the external face of the main vertical test wall immediately above the opening.

B.2 Apparatus

B.2.1 Thermocouples

B.2.1.1 General. Thermocouples shall be mineral insulated 1.5 mm (nominal) diameter thermocouples of Type K (Chromel/Alumel) with insulated junctions.

B.2.1.2 Three thermocouples in the combustion chamber, positioned (50 ± 10) mm below the top of the combustion chamber opening, (100 ± 10) mm behind the plane of the front face of the calibration boards. One thermocouple shall be positioned on the centre line of the combustion chamber opening, and the other two thermocouples shall be located (900 ± 10) mm either side of the centre line.

B.2.1.3 Five thermocouples at level 1, positioned to a tolerance of ± 10 mm with the hot junction positioned (50 ± 5) mm in front of the face of the calibration boards at level 1. These shall be located on the centre line and at distances of 500 mm and 1 000 mm each side of the centre line of the combustion chamber (see Figure B.1).

Dimensions in millimetres

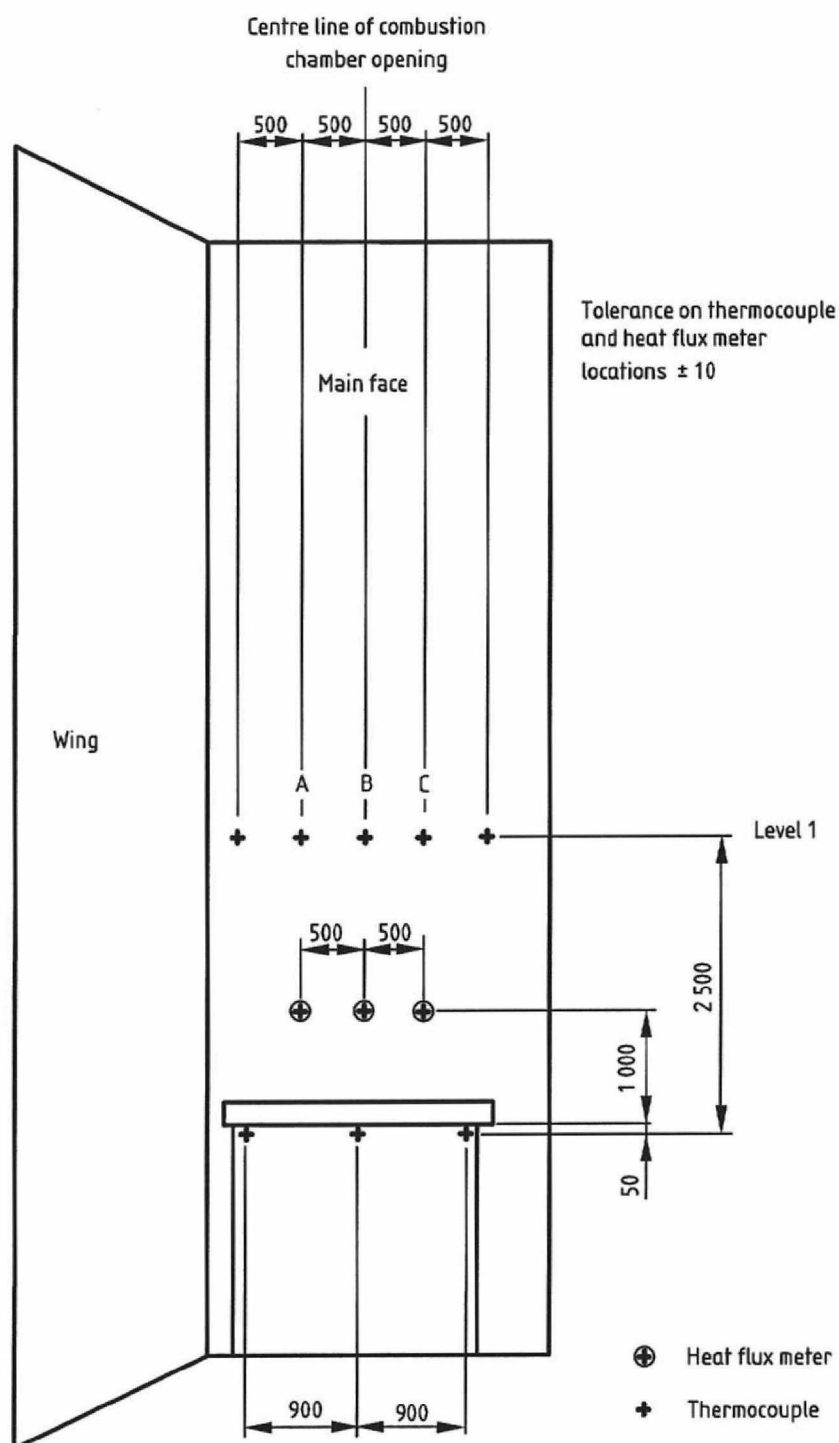


Figure B.1 — Location of heat flux meters and thermocouples for calibration test

B.2.2 *Three Gardon-type total heat flux meters*, with nominal size of 25 to 50 mm, with a measuring range 0 to 100 kW/m², placed (1 000 ± 100) mm above the chamber opening. These shall be located on the vertical centre line of the combustion chamber opening and (500 ± 10) mm either side (see Figure B.1). The measuring element of the heat flux meter shall correspond to the face of the calibration board exposed to the heat source.

B.3 Procedure

B.3.1 General

Follow the test procedure in Clause 8.

B.3.2 Temperature

B.3.2.1 Combustion chamber

The temperature across the width of the combustion chamber opening shall be monitored by the three thermocouples located as shown in Figure B.1. The mean reading of the three thermocouples shall exceed a 600 °C temperature rise above the start temperature, T_s , over a continuous 20 min period. The variation between the mean temperature reading and any one thermocouple over the 20 min monitoring period shall not exceed ±20 °C.

B.3.2.2 Level 1


The mean temperature of thermocouples A, B and C shown on Figure B.1, at level 1 height on the main face, shall exceed a temperature rise of 500 °C above T_s over a continuous 20 min period.

B.3.3 Heat flux

For fuel sources other than wood cribs, the mean heat flux measurement shall follow the profile exhibited in Figure B.2 and shall remain within the range of 45 to 95 kW/m² over a continuous 20 min period.

B.3.4 Duration

The nominal duration of the entire heating period shall be 36 min.

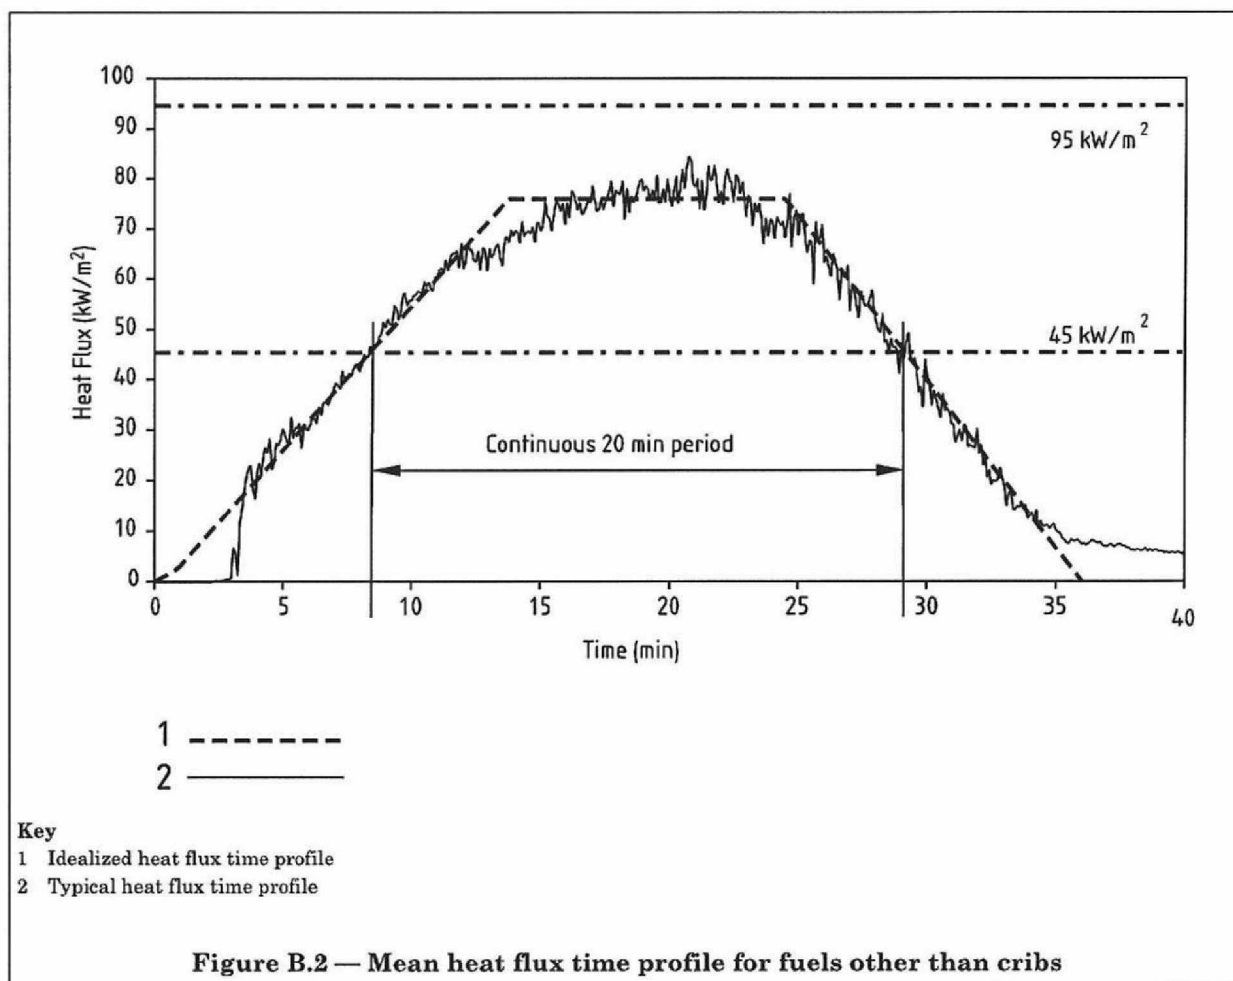

Annex C (normative)

Timber crib source

NOTE The heat source described in this annex has been found to meet the criteria of Annex B and may be used without the need for any calibration exercise.

C.1 Apparatus

C.1.1 Softwood sticks, with nominal dimensions of 50 mm × 50 mm cross-section and nominal lengths of 1 500 mm and 1 000 mm. At the time of test, the softwood shall have a moisture content in the range of 10 % to 16 % by mass.

C.1.2 16 strips of low density fibreboard, having nominal dimensions of (25 × 12 × 1 000) mm.

C.2 Procedure

C.2.1 Construct a timber crib nominally 1 500 mm × 1 000 mm in plane and 1 000 mm high of softwood sticks.

Construct the crib of alternate layers of long and short sticks, with the first layer consisting of ten 1 500 mm long sticks. The next layer shall consist of 15 short sticks evenly distributed to cover an area of 1 500 mm × 1 000 mm.

Repeat this process to give a total of 20 layers of sticks giving it a nominal height of 1 000 mm. In total, use 150 short sticks and 100 long sticks.

C.2.2 Construct the crib on a solid platform positioned (400 ± 50) mm above the base of the test frame. Locate the crib centrally in the combustion chamber and displaced (100 ± 10) mm from the back wall of the chamber (see Figure C.1).

C.2.3 Ignite the crib using 16 strips of low density fibreboard. Soak the strips uniformly for a minimum of five minutes with five litres of white spirit. Not more than five minutes before ignition, insert 14 strips into the spaces between the timber sticks in the second layer of the crib (i.e. 50 mm above the platform) allowing approximately 30 mm to project from the front of the crib. Place the remaining two strips horizontally across the 14 projected strip ends. Ignite only these two horizontal strips across their full length.

NOTE This heat source releases a nominal total heat output of 4 500 MJ over 30 min at a peak rate of (3 ± 0.5) MW.

C.2.4 When the crib is to be extinguished 30 min after ignition, care shall be taken to ensure that the minimum extinguishing agent is used, to reduce impact on any burning of the cladding system.

NOTE It has been found that dispersion and damping of the heat source is suitable.

Dimensions in millimetres

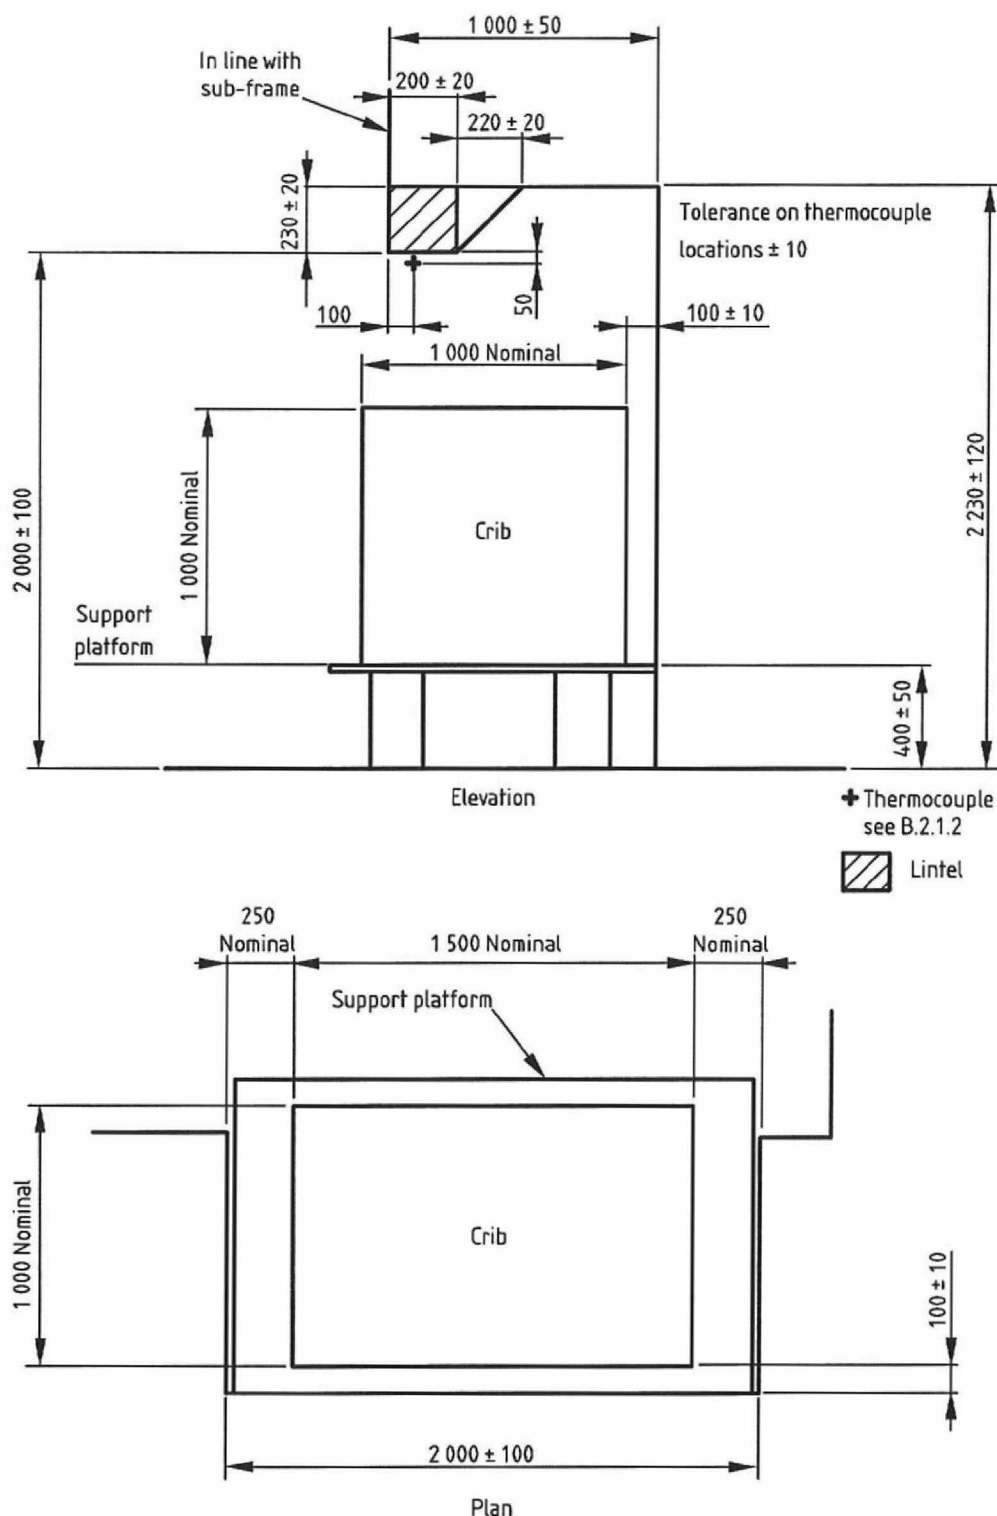


Figure C.1 — Elevation and plan of the combustion chamber

Bibliography

Standards publications

BS 8414-1:2002, *Fire performance of external cladding systems — Part 1: Test method for non-loadbearing external cladding systems applied to the face of a building*.

Other publications

[1] BUILDING RESEARCH ESTABLISHMENT Fire Note 9: *Assessing the fire performance of external cladding systems: a test method*. London: Construction Research Communications, 151 Rosebery Avenue, London EC1R 4QX.

[2] GREAT BRITAIN. Parliament. House of Commons Environment, Transport and Regional Affairs Committee (BENNETT, A.F.). 1st report, session 1999-00. *Potential risk of fire spread in buildings via external cladding systems — Report and proceedings of the Committee*. House of Commons papers 1999-00 109. January 2000. London: The Stationery Office.

[3] GREAT BRITAIN. Approved Document B to Part B of Schedule 1 to the Building Regulations 2004. London: The Stationery Office.

Further reading

BUILDING RESEARCH ESTABLISHMENT. Report BR 135: *Fire performance of non-loadbearing external cladding systems*. London: Construction Research Communications, 151 Rosebery Avenue, London EC1R 4QX.

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001. Fax: +44 (0)20 8996 7001. Email: orders@bsi-global.com. Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre. Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: info@bsi-global.com.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001. Email: membership@bsi-global.com.

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager. Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553. Email: copyright@bsi-global.com.

BSI
389 Chiswick High Road
London
W4 4AL